

**Military Technical College
Kobry El-Kobbah,
Cairo, Egypt**



**8th International Conference
on Electrical Engineering
ICEENG 2012**

**Optimization of Renewable Energy Power System for Small Scale Brackish
Reverse Osmosis Desalination Unit and a Tourism Motel in Egypt**

F. H.Fahmy, N. M. Ahmed and H. M. Farghally
Farghally555@yahoo.com
Electronics Research Institute,

El-Tahrir St., El-Dokki, Giza, Egypt

Abstract

The main objective of this work is to design an optimal – efficient economic power renewable energy system that feeds the required electric load of a small scale brackish reverse osmosis desalination unit and a tourism motel located in Hurghada, Egypt. Three renewable energy power systems are presented in this paper to select the most optimum one of them. These suggested renewable energy systems are stand-alone photovoltaic system, PV- wind-fuel cell hybrid system and PV- wind hybrid system. The sizing, optimization and economic estimation of the proposed systems were performed using HOMER software. HOMER solves the optimization problem to minimize the global cost and provides the optimum wind turbine, PV, battery and fuel cell ratings. In addition, a comparison between the three different suggested power system configurations is illustrated in details. PV- wind hybrid system realized the lowest net present cost and leverized cost of energy. Also, this system was able to provide energy approximately all the day. The battery state of charge varies between 77% to 100% and it was found that, the PV- wind hybrid system is more suitable than the others for the selected site and the suggested electrical load.

Keywords: PV, Wind turbine, Fuel cell, Hybrid system, Net present cost, HOMER.

1. Introduction

As the energy demands around the world increase, the need to alternative energy sources is increased. In addition to, the rapid depletion of conventional energy (fossil fuel) resources on a worldwide basis has necessitated an urgent search for alternative energy sources to cater to the present day demands. The clean green renewable sources of energy are expected to play more significant role in the global energy future. Also, with the increasing concerns on air pollution and global warming, the clean renewable energy sources that are environmentally friendly, unexhausted e.g. solar energy, wind, hydrogen, geothermal ...etc. have attracted energy sectors to generate power on a large scale. Wind and solar energy technologies are the forerunners amongst various types of renewable sources [1-2]. The vast and continuous development of the Red Sea zone has led to extensive and increasing potable water demands to match the tourist, industrial and urban settlements. Given

the worsening water situation in Egypt due to the massive and increasing demand by the agricultural sector, supplementary non-conventional sources including desalination of sea and brackish water, and reuse of waste water, represent very important sources to ensure maximum water allocation for its uses [3] .Also, water demand in a vastly growing and developing Egyptian community was analyzed as characterized by a rising standard of living, expansion of industrialization in mining and petroleum sectors and the vast expansion of tourist development [4].There are different methods of seawater and brackish desalination appropriate for Egyptian environment and recommended the method of selection of the technology to be used in each particular site where the possible energy sources are screened. A small scale RO desalination system powered by renewable energy sources presents an ideal solution to provide freshwater to small communities isolated at remote areas [5].In the last decade, desalination, especially by reverse osmosis (RO), has become one of the principal safe sources of supply of potable water, and even water for agricultural use, it is in the Mediterranean, Africa, the Middle East, and so on, where the potable water supply is a high priority problem. All this leads to the need to identify new sources of supply such as the desalination of brackish or sea water [6 -7].Coupling of renewable energy and desalination systems holds great promise for increasing water supplies in water scarce regions. An effective integration of these technologies will allow Egypt to address water shortage problems with a domestic energy source that does not produce air pollution or contribute to the global problem of climate change. Meanwhile the costs of desalination and renewable energy systems are steadily decreasing [8], while fuel prices are rising and fuel supplies are decreasing. In addition, the desalination units powered by renewable energy systems are uniquely suited to provide water and electricity in remote areas where water and electricity infrastructure is currently lacking [9-11]. As the energy cost is one of the most important elements in determining water costs where the water is produced from desalination plants. The aim of this work is to design an optimum –efficient cost power renewable energy system for powering brackish water reverse –osmosis desalination system to deliver in the order of 5 m³ of fresh drinking water per day required for feeding a tourism motel plus electrical power for supplying the main equipments required for a motel with the electrical power demand, This study is performed for the region in Hurghada in Egypt. Three power system configurations using different energy storage technologies, namely, stand-alone photovoltaic system, PV- wind -fuel cell hybrid system and PV- wind hybrid systems are studied in this paper. Also, a comparative study between these different power systems configurations is introduced. These different system configurations are simulated in HOMER environment for sizing optimization which minimizes the system cost. Also, the simulation results are reported in this paper.

2. Proposed Reverse Osmosis Desalination Unit

Reverse Osmosis process is used chiefly for separating the solvent (water) from aqueous salt solutions. The brackish water, pumped from a well to a storage tank, passes through the desalination unit and exits in two branches, one as potable water that is stored in special tank and another as brine water (elevated salinity) that is directed to an evaporative pond. The feed water enters the unit at a salinity value of around 3400 ppm and exits as fresh water permeate at a salinity of around 30 ppm. An external mixing process is arranged at the exit to produce water for consumption at a salinity level of around 300 ppm.

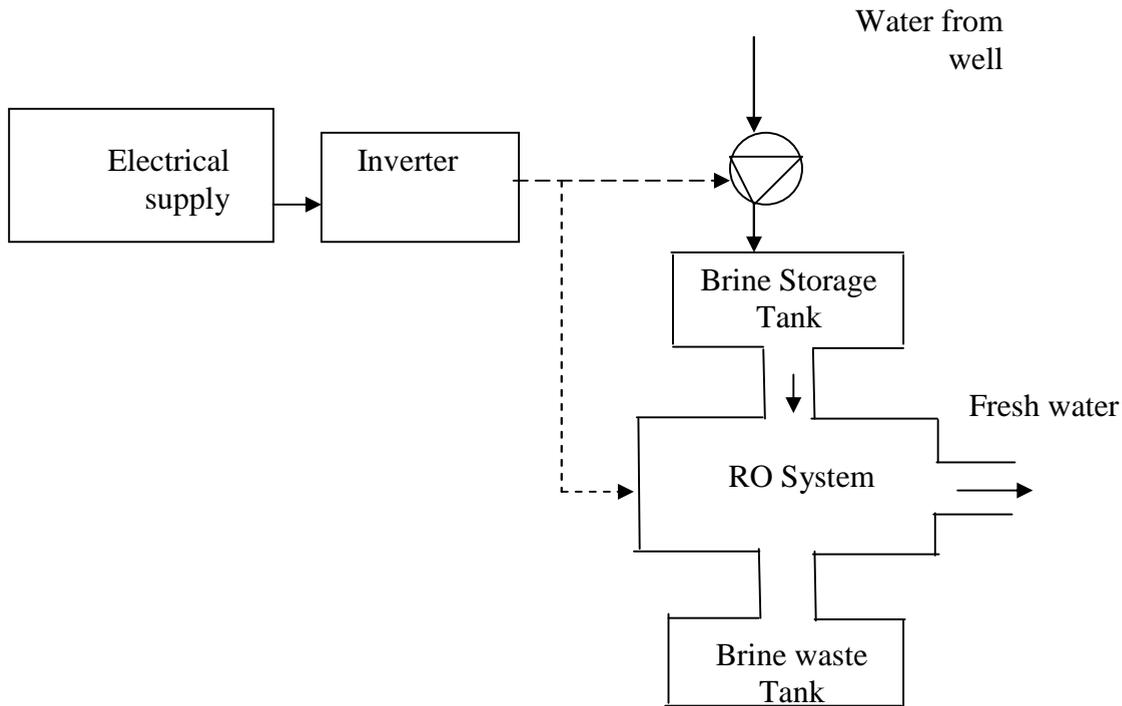


Fig. 1 Block Diagram of RO System.

3. Load Data:

The main goal of system sizing is to achieve the right balance between daily needs of electrical energy consumed by the loads and daily produced electrical energy by the generator. The daily consumed electrical energy by the loads has to be identified at the beginning of system sizing, so as to calculate the daily needed electrical energy and the total peak power of the generator. Also, it is very important to determine the amount of water consumed by 20 motel inhabitants and the amount of water required for the daily operation of the motel which is calculated to be around 5 m³/day. Therefore, the required electrical load consists of the power needed for supplying the small scale RO desalination unit and the electricity required to operate the domestic electrical load of the motel. According to Reverse Osmosis manufacturer [12-13] power required to produce 5 m³ per day is 1.8 kW. This means that, the daily energy required for desalination unit is approximately 45kWh. The BWRO (brackish water reverse osmosis) load is assumed to operate for 24 hours from 0:00 to 24:00. Also, the motel is populated by approximately 20 inhabitants (15 guests and 5 workers) and includes a kitchen, a small garden and a small swimming pool. Figures 2 and 3 shows the estimated daily load power variation in summer and winter respectively for a small scale RO desalination unit and a tourism motel located in Hurghada in Egypt, with a full load of 8.5kW as shown in these figures. Table 1 shows the daily electrical load requirement of RO unit and the motel total load of appliances.

Table1: The daily electrical load requirement.

Appliance	No. of units	rated power (W)
Reverse osmosis unit	1	1800
TV	1	80
Refrigerator	1	100
Energy saving lamp	2	40
Indoor lamp	18	20
Fan	18	100
Washing machine	1	1000
Blower	1	100

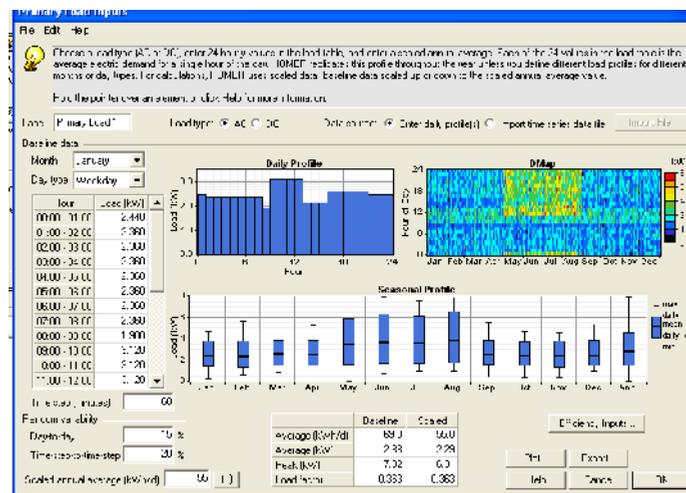


Fig 2: Daily Load data in winter.

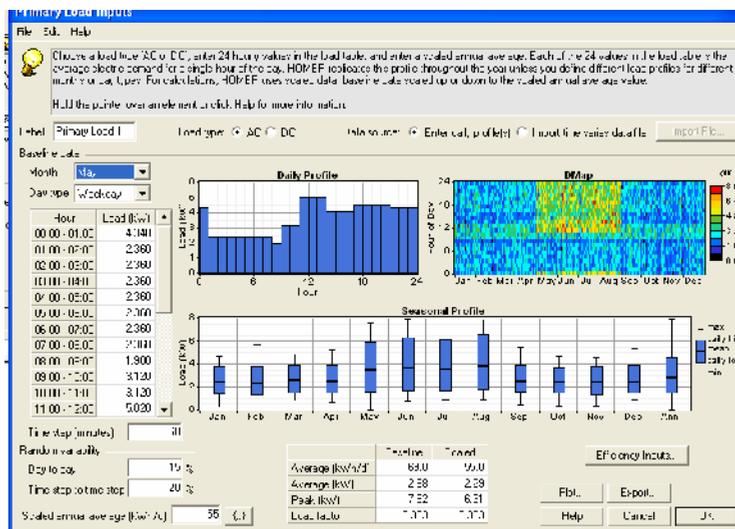


Fig 3: Daily Load data in summer.

4. Site Characteristics

Site selection is based on the following criteria [14]:

- * Availability of brackish groundwater.
- * Potential of solar radiation.
- * Electric grid and fresh water network are not available in the vicinity of the site.
- * The social, economic and ecological situation of the beneficiaries.
- * The demand for fresh water

Hurghada city is the chosen zone as the site under consideration. It is located at 27° 17 'N latitude, 33° 46'E longitude, elevation 1m and Red sea climate district. The city is characterized by an intensive solar radiation. Wind is also an abundant resource. Two water wells are selected to be the water supply for the reverse osmosis desalination unit. These wells are Abu Shegala and Umm Huweitat wells. Each has a depth of 160 m and is located near Hurghada city [15]. Since the performance of renewable energy power system is highly dependant on the environmental conditions, a site-specific analysis is required to investigate the associated cost, component size and overall economics.

5. Resources

The types of renewable energy sources available in the coastal areas are those of the sun and the wind. Wind and solar energy resources of Hurghada city are considered for this study.

a. Solar Energy source

The use of photovoltaic technology, especially in regions without access to electrical energy from a central power grid but good solar resources, can play a significant role in meeting the power demand to run a water-desalination plant. Red-Sea Coast is known as a rich area of solar energy and high wind speed. The available solar resource greatly influences both the configuration and the cost of a hybrid system. Monthly average solar insolation data for the selected remote area is shown in Fig. 4. We notice from this figure that, the highest values of the solar insolation are during the summer months (May, Jun., Jul, and Aug.) and the lowest values are during the winter months (Nov, Dec. and Jan.). Solar radiation data for this region was obtained from Egyptain Solar Radiation Atlas [15]. The annual average solar radiation for this area is 6.38. kWh/m²/d.

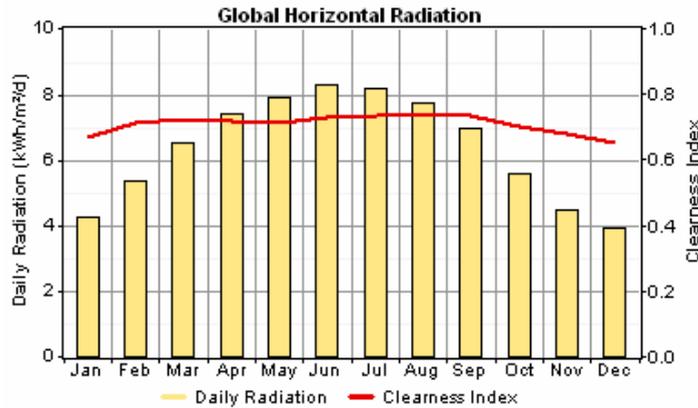


Fig 4: Averages Solar Radiation Profile for Hurghada city

b. wind Energy Source

Among the coastal areas, the zone of Hurghada is the highest in wind energy applications. A monthly average wind speed for Hurghada city was obtained from Egyptian Solar Radiation Atlas. As it is cleared from Fig. 5, the most year months have wind speed values ranging from 5.7 m/s to 7.8 m/s. The annual average wind speed in Hurghada is found to be 6.93 m/s [15].

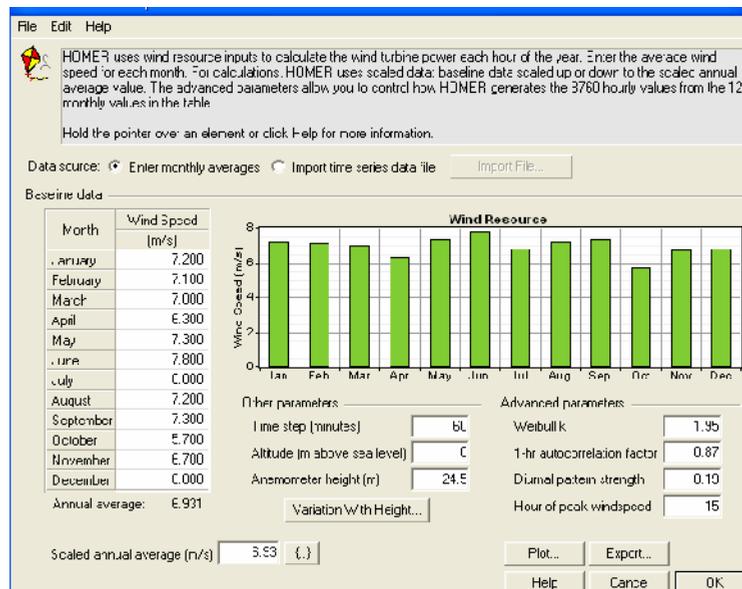


Fig 5: Averages wind speed Profile for Hurghada city.

6. Systems Components

In addition to renewable energy sources (wind and solar), various combinations of PV array, wind turbine, fuel cell, electrolyzer, battery, and power inverter modules were taken into account towards identifying an economic solution that would meet the required load [16].

6.1 Photovoltaic Panels

In this study, photovoltaic panels were specified with capital and replacement costs of 8000\$ and 7000\$ respectively, this cost includes shipping, tariffs, installation, and dealer markups. Some maintenance is typically required for the batteries of a PV system. A derating factor of 80% was applied to the electric production from each panel. This factor reduces the PV production by 20% to approximate the varying effects of temperature and dust on the panels. The panels were modeled as fixed and tilted south at an angle equal to the latitude of the site.

6.2 Wind Turbine

In this analysis, Bergey Wind Power's BWC Excel-R/48 model is considered [17-18]. It has a rated capacity of 7.5 kW and provides 24 V dc as output. Cost of one unit is considered to be \$1200 while replacement and maintenance costs are taken as \$800 and \$75/year respectively[16]. The life time of the turbine is estimated to be 20 years.

6.3 Fuel Cell

The fuel cell considered in this study has a capacity of 1 kW. Its initial cost is \$3000 and its replacement is \$2500. Annual operation and maintenance cost is \$175. The life time of fuel cell is estimated to be 5 years.

6.4 Electrolyzer

Water electrolyzer consists of several cells connected in series. Two electrodes of the electrolyzer are separated by an aqueous electrolyte or solid polymer electrolyte. Electrical current through the electrolyzer enables the decomposition of water into hydrogen and oxygen.

The capital cost of one kilowatt of the electrolyzer includes electrolyzer electronics is 2000\$. The replacement cost of the electrolyzer is assumed to lower than the capital cost because some components included in the capital cost have longer life time than the stack itself. The replacement cost is 1500\$. A durability of 20 years was given within the scope of this simulation.

6.5 Hydrogen tank

Hydrogen storage tanks are also included in the electrolyzer model. Cost of a tank with 1 kg capacity is assumed to be \$1300. The replacement and operational costs are taken as \$1200 and \$15/year respectively.

6.6 Batteries

One of the major requirements for renewable energy power systems is to ensure continuous power flow by storing excess energy from the renewable sources. Torgan L16P lead acid battery type was chosen because it is a popular and inexpensive option. HOMER considered from 0-20 of these batteries. The voltage regulated lead acid battery is rate at 24V and has a capacity 360Ah. Initially cost for one battery is \$275. The replacement batteries will cost another \$275. The operation and maintenance cost add further 3\$ with a minimum life time of 5 year [17].

6.7 Inverter

A reliable and efficient power electronic inverter is needed to maintain flow of energy between the ac and dc components. The inverter size of 1 kW is taken in this model. Lifetime of the inverter is considered to be 15 years with an efficiency of 90%. It is

one of the major cost of the system. For a 1 kW inverter ,the initial and replacement costs for the inverter each is \$700, with no cost for operation and maintenance [17-18].

7. Basic Economical Modeling

The total Net Present Cost (*NPC*) of the power system is the objective function to be minimized in the optimization process. To calculate the *NPC* of the system we simulate it throughout its lifetime, obtaining the energy produced and consumed by the components, their own lifetimes, the number of times in which the components must be replaced, the operating and maintenance costs, the fuel costs, etc.

The renewable energy system cost represented by the net present cost (*NPC*) is expressed as:

$$C_T = \sum_{i=1}^m C_I + CM\&O_i + CR_i - CS_i$$

Where C_T is the total system cost, This cost takes into account the initial (capital) and all other costs required for the system to operate properly over its life. m is the number of used energy sources, five main parts are considered: PV array, wind turbine, battery bank, fuel cell and the inverter. C_I is the initial capital cost, CR is the replacement cost, $CM\&O$ is the operation and maintenance cost and CS is the salvage value at the end of the project [19--21].

8. Simulation:

We perform the simulation to obtain the optimum power system configuration that meets the previously mentioned load profile. National Renewable Energy Laboratory (NREL)'s, Hybrid Optimization Model for Electric Renewables (HOMER Version. 268Beta) has been used as the sizing and optimization software tool. It contains a number of energy component models and evaluates suitable technology options based on cost and availability of resources [22-23]. Analysis with HOMER requires information on resources, economic constraints, and control methods.

The three previously mentioned power system configurations which are submitted to the technical and economical analysis can be addressed as follow:

Power system 1 : "PV- wind hybrid system".

Power system 2: "stand-alone PV system".

Power system 3 : "PV- wind -fuel cell hybrid system".

9. Optimization Results

The simulation results of the three power system configurations are displayed in Table 2 .Power system 1, which is the PV-wind- battery hybrid system offers the much lower *NPC* and Levelized cost of energy (LCOE) with PV and wind combined together. On the other hand, power system 3 has higher initial capital costs, *NPC* and LCOE. It is evident from this table that, PV-wind- battery

system configuration is the most economic solution under given resources and load conditions. Also, the high PV- wind -fuel cell power system cost over PV-battery system is due to the high capital cost of fuel cell system and electrolyser compared to the battery. Economic competitiveness for hydrogen energy systems is obtainable only with a significant reduction of capital costs together with a strong decrease in energy prices. According to the results of the optimization process the optimal power system comprises a 5 kW PV array, a 7.5 kW wind turbine, a 10 kW inverter and 5 batteries. Figure 6 shows the PV-wind-Battery hybrid system architecture simulated in HOMER. The proposed system gives us a total net present cost of \$67,695. The cost of energy is 0.336 \$/kWh and the initial capital required is \$46,075.

Table 2 Optimization Sizing results.

tem	Power system 1 PV-Wind- Battery system	Power system 2 PV- Battery system	Power system 3 PV- wind - fuel cell system
Optimization sizing result s	5 kW PV array 7.5 kW wind turbine 5 battery each 8.64 kW h 10 kW inverter	8 kW PV array 15 battery each 8.64 kW h 10 kW inverter	100 kW PV array 120 KW wind turbine 14 Kw fuel cell 80 kW electrolyzer 50 kg hydrogen tank 10 kW inverter
Capital Cost (\$)	46,075	71,625	799,800
O&M (\$)	2,247	470	37,790
Replacement cost (\$)	22,528	40,690	127,996
Net Present cost \$(NPC)	67,695	106,816	903,281
Levelized cost of energy (LCOE) (\$/kWh)	0.336	0.552	4.305

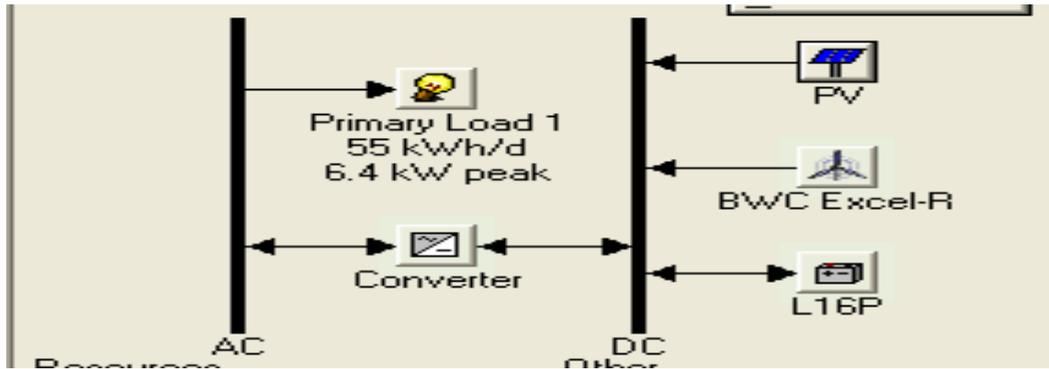


Fig. 6. HOMER implementation of the PV-wind-battery hybrid system.

As shown in Fig. 7 the load is supplied with a hybrid system comprising of a PV array, wind generator and battery storage. As cleared, the PV/Wind hybrid system is able to provide energy approximately all time of the day. It can be observed that, the load could be met right through the day. The battery state of charge varies between 77% to 100%. Fig.8 presents the same hourly data but for PV stand alone system. A PV stand alone system may not easily satisfy loads on 24-h basis as the variation of solar electricity generation does not always match with the time distribution of load demand. As shown the battery state of charge varies from 33 % to 60 %. The battery is discharged long and several times during the day with a short charging time that may affect the battery life time. Fig. 9 presents the hourly data for PV – wind – fuel cell hybrid system. As shown in this figure, the system easily satisfies loads on 24-hours basis.

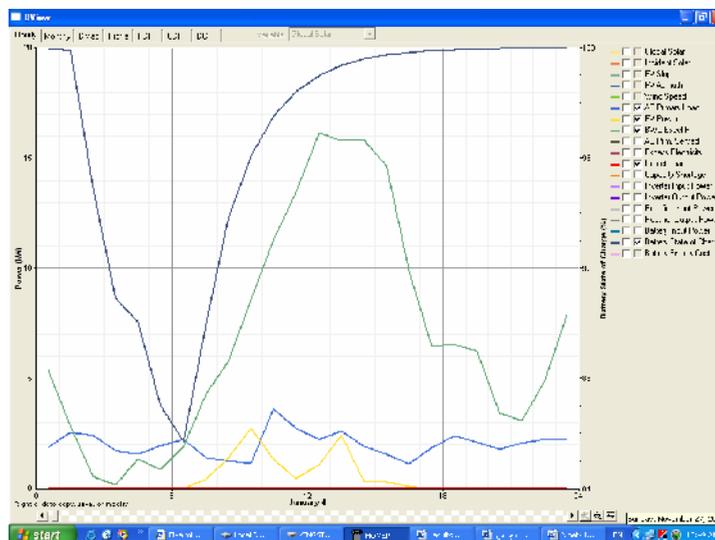


Fig.7 Hourly data for power system 1.

and a tourism motel was developed. The computer program (HOMER Pro.) solves the optimization problem to minimize the objective function considering the different constraints and provides the optimum wind, solar and battery ratings. In addition, the comparison between the three suggested different power system configurations was illustrated with details. These systems are compared with respect to the total net present cost (NPC) and levelized cost of energy. The PV-wind- battery system, offers the much lower NPC and LCOE. On the other hand, PV-fuel cell wind hybrid system has higher initial capital costs, NPC and LCOE. PV-wind- battery system configuration comprising of 5 kW PV array, a 7.5 kW wind turbine and 5 batteries each has a capacity of 8.64 kWh is the most economic solution under given resource and load conditions. Also, the high PV-wind- fuel cell system cost over PV-battery system is due to the high capital cost of fuel cell system and electrolyser compared to battery. Therefore, the major obstacle in using hydrogen as a storage medium is the high cost associated with it.

References:

- [1] Doaa M. Atia, Faten H. Fahmy, Ninet M. Ahmed, and Hassen T. Dorrah, " Comparative Study of PV-Wind Power Systems for Aquaculture System using Genetic Algorithm", International conference on , 9-12 Oct. 2011, Alex., Egypt
- [2] H. Aybar, J. S. Akhatov, N. R. Avezova, and A. S. Halimov, "Solar Powered RO Desalination: Investigations on Pilot Project of PV Powered RO Desalination System1", Applied Solar Energy, 2010, Vol. 46, No. 4, pp. 275–284. © Allerton Press, Inc., 2010.
- [3] H. S. Aybar, J. S. Akhatov, N. R. Avezova, and A. S. Halimov, " Solar Powered RO Desalination: Investigations on Pilot Project of PV Powered RO Desalination System1", Applied Solar Energy, 2010, Vol. 46, No. 4, pp. 275–284.
- [4] Diego Alarcón, Julián Blanc, o Sixto Malato, M. Ignacio Maldonado. Pilar Fernández " Design And Setup Of A Hybrid Solar Seawater Desalination System: The Aquasol Project",
- [5]Alaa El-Sadek, "Water desalination: An imperative measure for water security in Egypt", Desalination , Volume 250, Issue 3, 30 January 2010, Pages 876-884.
- [6] T. Espino, B. Peñate#, D. Henríquez, J. Betancort, G. Piernavieja, "Seawater desalination plant by reverse osmosis powered with photovoltaic solar energy. A supply option for remote areas", 1-11.
- [7] www.deswater.com, Desalination and Water Treatment 7 (2009) 285–296 1944-3994 / 1944-3986 © 2009 Desalination Publications. All rights reserved.
- [8] Essam E. Khalil, "Water strategies and technological development in

Egyptian coastal areas", Desalination 165 (2004) 23–30.

[9] Ali Al-Alawi and Syed Islam, " Estimation Of Electricity Demand For Remote Area Power Supply Systems Including Water Desalination And Demand Side Management Models".

[10] Evangelia Gkeredaki, "Autonomous Photovoltaic-Powered Reverse Osmosis For Remote Coastal Areas", Date of defense: 16th June 2011.

[11] Zejli, O-K. Bouhelal, R. Benchrif, A. Bennouna. " Applications Of Solar And Wind Energy Sources To Sea-Water Desalination-Economical Aspects", International Conference on Nuclear Desalination : Challenges and Options. 16 – 18 October, Marrakech, Morocco.

[12] MARWAN M. MAHMOUD, " Solar Electric Powered Reverse Osmosis Water Desalination System For The Rural Village Al Maleh: Design And Simulation", Int. J. of Solar Energy, 2003, Vol. 00, pp. 1–12.

[13] Citor .com.au Website, June 2002 the official website of Citor Pty. Ltd Company. Fremantle, Western Australia.

[14] Ahmed Muhaidat , Malek Kabariti, Kenell Touryan, Allan Hoffman, " Design, Sizing and Simulation of Solar Powered Desalination Unit for Brackish Water in Jordan".

[15] Egyptain solar radiation atlas, Cairo, Egypt, 1998.

[16] Kh.Abulqasem, M.A. Alghoul, M. N.Mohammed, Alshrif.Mustafa, Kh.Glaiza, Nowshad.Amin, A.Zaharim and K.Sopian, Optimization of Renewable Power System for Small Scale Seawater Reverse Osmosis Desalination Unit in Mrair-Gabis Village, Libya" Recent Researches in Applied Mathematics, Simulation and Modelling, 155-160.

[17] M.J. Khan, M.T. Iqbal, " Pre-feasibility study of stand-alone hybrid energy systems for applications in Newfoundland", Renewable Energy 30 (2005) 835–854.

[18] Belgin Emre TÜRKAY, " Selection of Optimum Hybrid Stand Alone Systems"Proceedings of the 14th International Middle East Power Systems Conference (MEPCON'10), Cairo University, Egypt, December 19-21, 2010, Paper ID 321.994.

[19] Ali Naci Celik , "Present status of photovoltaic energy in Turkey and life cycle techno-economic analysis of a grid-connected photovoltaic-house" Renewable and Sustainable Energy Reviews10 (2006) 370–387.

[20]Rodolfo Dufo-López, José L. Bernal-Agustín¹, Javier Contreras, "Optimization of Control Strategies for Stand-Alone Renewable Energy Systems with Hydrogen Storage", Paper accepted for publication in Renewable Energy (<http://www.sciencedirect.com/science/journal/09601481>) DOI:10.1016/j.renene.2006.04.013.

[21] Sultan A. Kershrnana, Jtigen Rhein&nde, Hansjijrg Gablerb, " "Seawater reverse osmosis powered Tom renewable energy sources - hybrid wind/photovoltaic/grid power supply for small-scale desalination in Libya", Desalination 153 (2002) 17-23.

[22] J. Cotrell, W. Pratt, "Modeling the Feasibility of Using Fuel Cells and Hydrogen Internal Combustion Engines in Remote Renewable Energy Systems", September 2003, NREL/TP-500-34648.

[23]_Prabodh Bajpai, Sowjan Kumar, and N. K. Kishore," Sizing Optimization and Analysis of a Stand-alone WTG System Using Hybrid Energy Storage Technologies" PEA-AIT International Conference on Energy and Sustainable Development: Issues ,and Strategies (ESD 2010).

[24] Homer Energy ver. 268Beta, LLC858 Arapahoe Ave Boulder,Co.80302,USA